

5. Comparison of Available Resource Capacity and Future Needs

Figure 5-1: Floridan Aquifer Demand vs. Estimated Yield

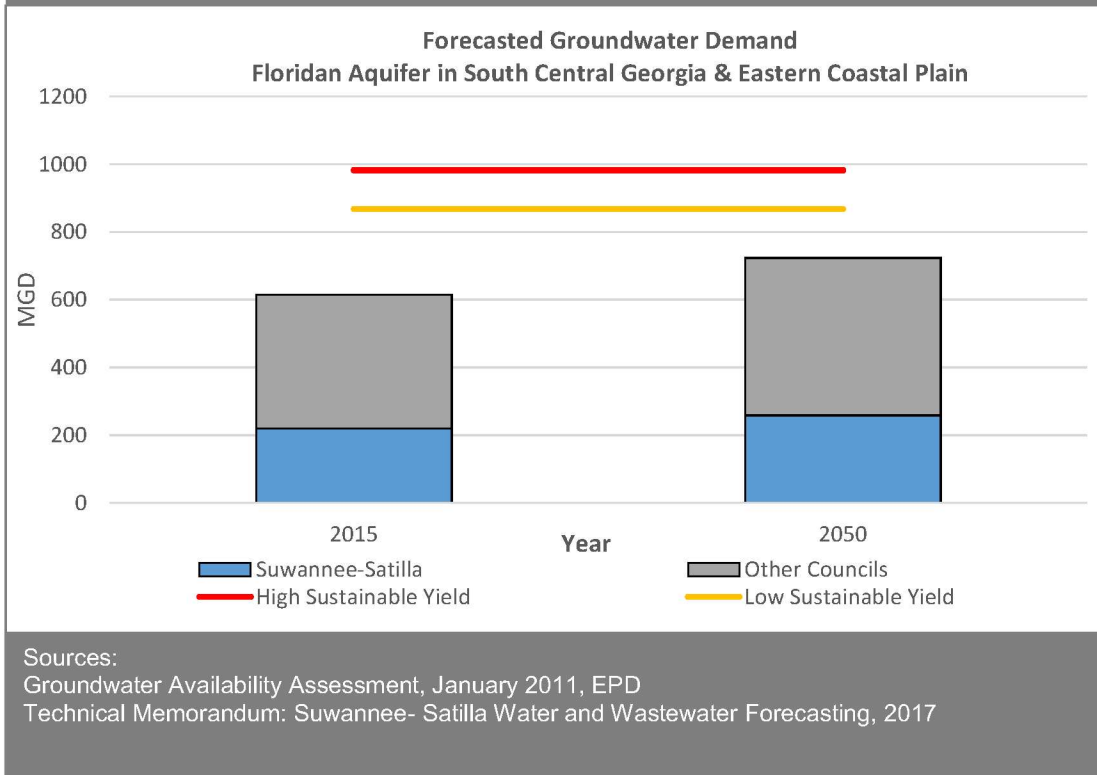


Table 5-1: 2050 Municipal Forecast versus Groundwater Permitted Capacity

County	2015 Public Demand Forecast (AAD – MGD)	2050 Public Demand Forecast (AAD – MGD)	Existing Groundwater Permitted Capacity (AAD-MGD)	Additional Permitted Capacity Needed in 2050 (MGD)*
Atkinson	0.43	0.38	0.90	-
Bacon	0.66	0.80	1.50	-
Ben Hill	2.47	2.63	5.50	-
Berrien	1.10	0.83	1.73	-
Brantley	0.25	0.24	0.20	0.04
Brooks	0.97	0.73	3.55	-
Charlton	0.71	0.75	1.40	-
Clinch	0.45	0.42	0.75	-
Coffee	2.53	2.95	6.80	-