

graphic are related to Table B-18 in Appendix B. Arrows in the graphic show the location of the WWTF.

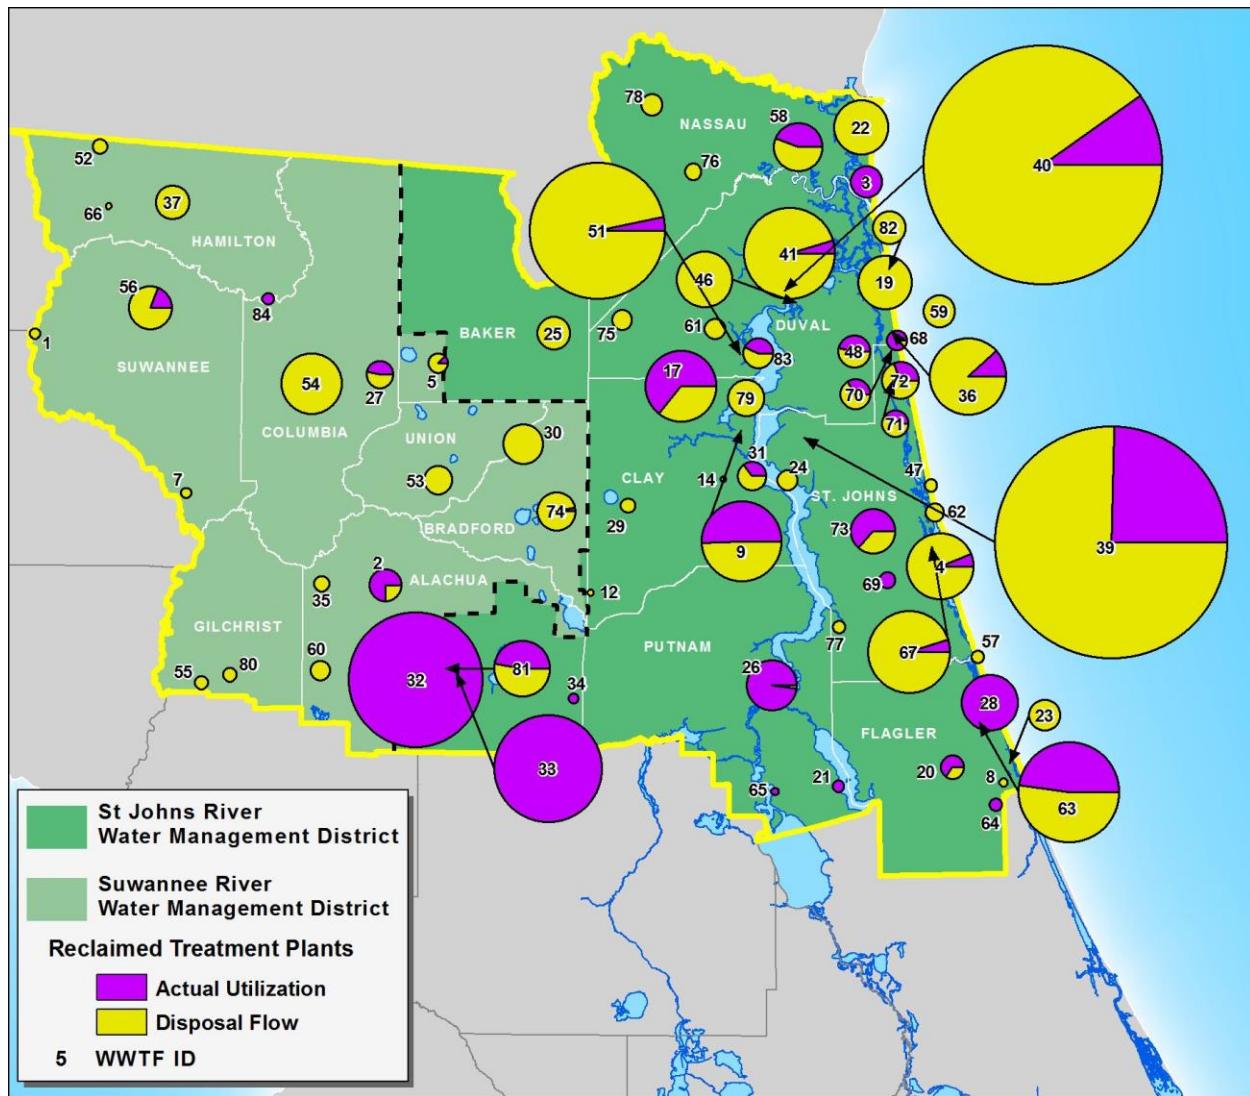


Figure 14: Summary of 2015 Reclaimed Water Flows in the NFRWSP

Future Flows

The Districts identified WWTFs that could potentially receive additional sewer flow as a result of population growth. It was assumed that 95 percent of the population increase identified will receive sewer service and thereby return wastewater for treatment. It is acknowledged that the percentage of sewer population growth and resulting wastewater flows will vary for individual service providers due to a number of factors.

It was further assumed that the increased sewer population will generate approximately 84 gpcd of wastewater to the local WWTF (sources are identified in